
Lightcloud Integrator

The Lightcloud Gateway must be hard-wired to AC power.

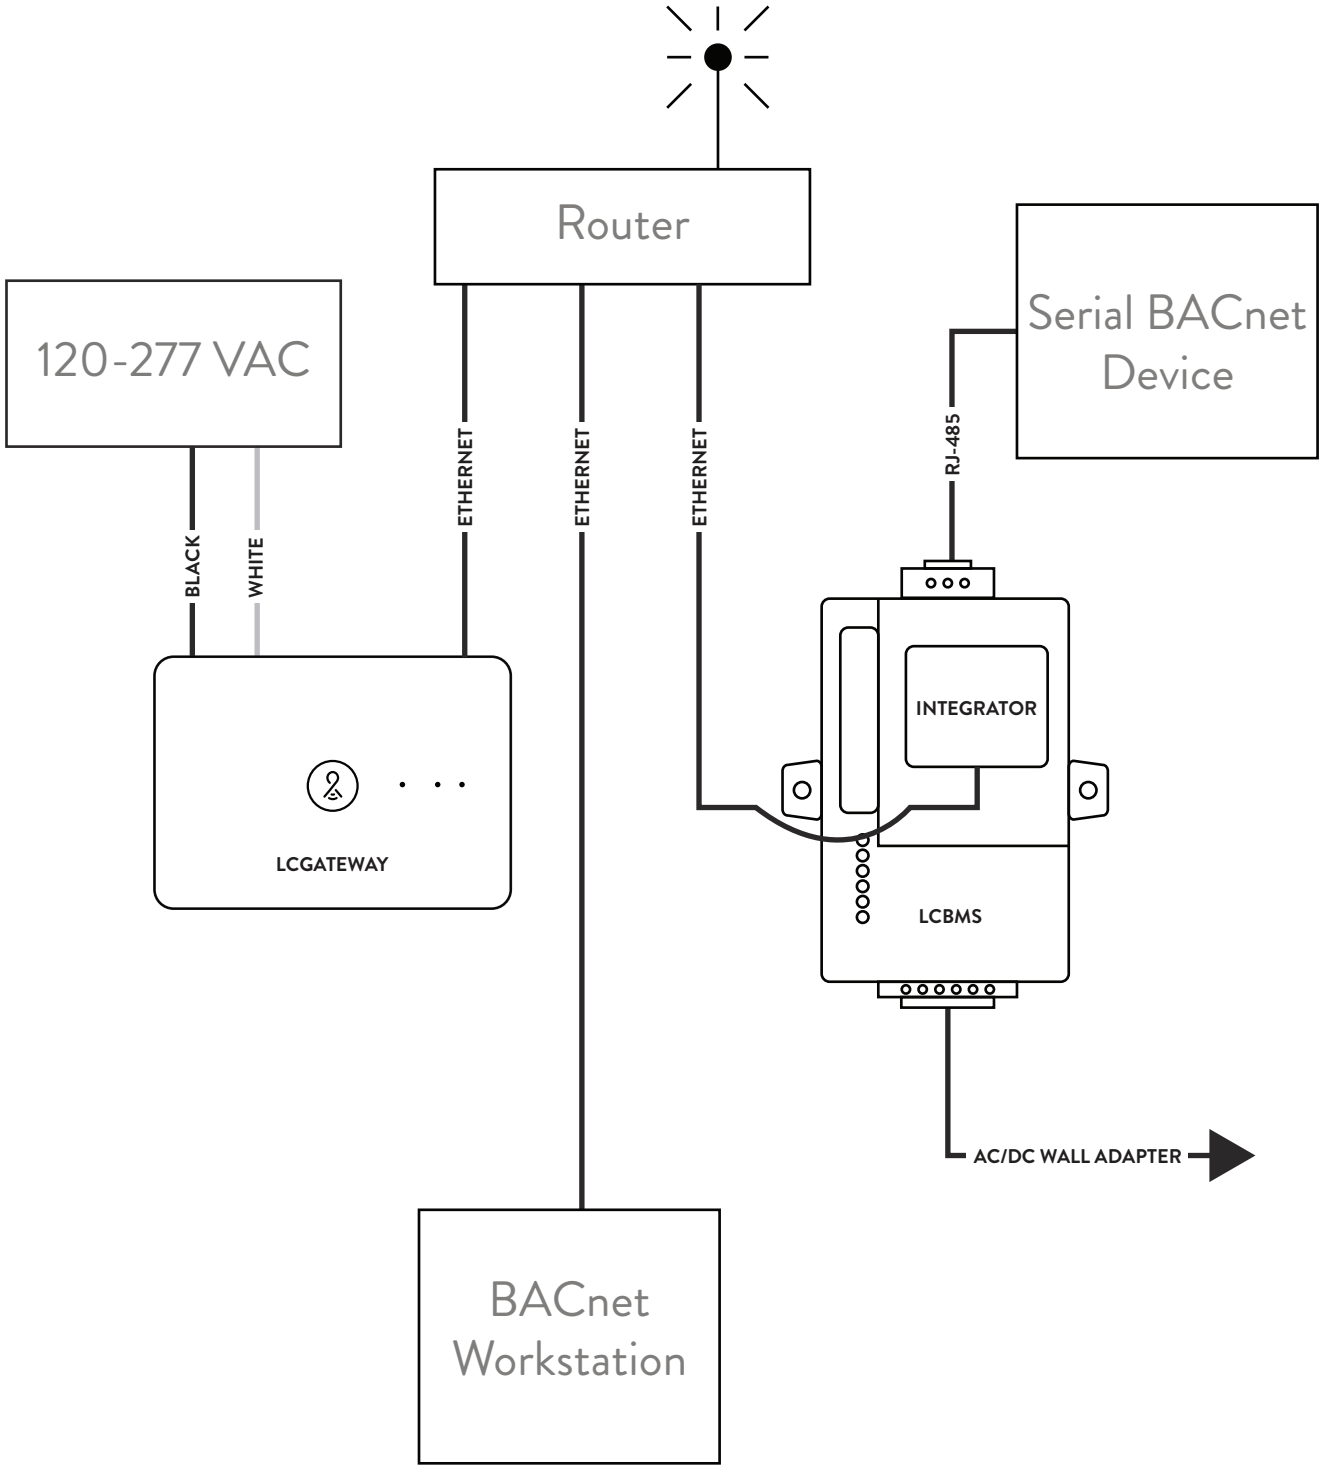

Input: 9-30 VDC or 12-24 VAC

Any wires not in use must be capped off or otherwise insulated.
This product should only be installed by a qualified electrician and in compliance with local and national electrical codes.

RAB | Controls